


# Installation manual

Carat XXL Tank



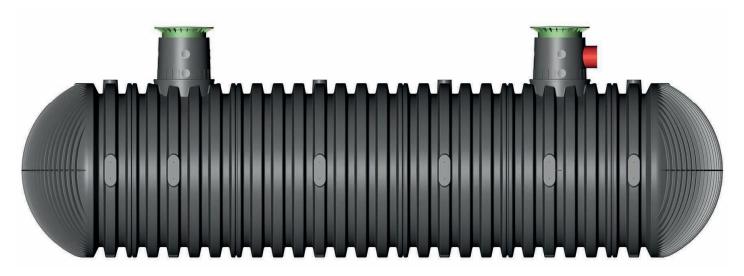

#### 1. GENERAL NOTES

The points described in these instructions must be followed correctly. If not correctly observed, any right to claim on the warranty may be refused.

Any missing instructions must be requested directly from us.

A complete check of all the items/components for possible damage must be carried out before the assembly or installation begins.

The installation must be carried out in a professional manner.


#### Safety

The relevant accident prevention regulations must be observed during all work.

The relevant regulations and standards must additionally be taken into consideration during installation, assembly, servicing, repair, etc. Relevant notes can be found in the corresponding sections of these instructions.

During all work on the system or parts of the system, the entire system must always be rendered inoperable and secured to prevent unauthorised reactivation.

Except in the event of work carried out in the tank, the cover of the tank must always be kept sealed, as this otherwise constitutes a maximum risk of accident. The rain protection installed on delivery is merely transportation packaging. It cannot be walked on and is not child-proof; it must be replaced with a suitable cover immediately following delivery (telescopic dome shaft with corresponding cover)! Only original GRAF covers or covers approved in writing by GRAF must be used.

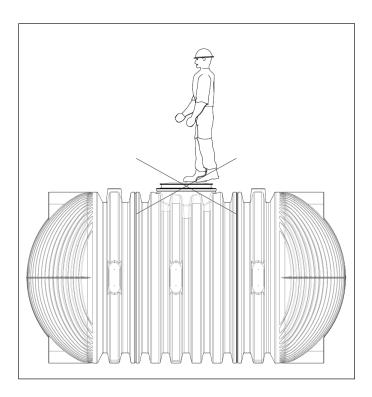

GRAF offers an extensive range of accessories, all of which are designed to match each other and which can be extended to form complete systems. The use of accessories that have not been approved by GRAF results in the exclusion of the warranty/guarantee.


#### Identification obligation - Regulation


The water in these systems is not suitable for consumption or personal hygiene.

All pipe-work and outlets of the water systems are to be labelled with the words "Not drinking water" either in words or graphically. (British Standard BS EN 16941-1:2024) so that after years of use, an accidental connection to the drinking water system is prevented. Even when correctly labelled it may possibly be mistaken, for example by children. For this reason, all the outlets of the systems process water must be fitted with child safe valves.

### 2. TECHNICAL DATA

#### 2.1 Technical Data Carat XXL

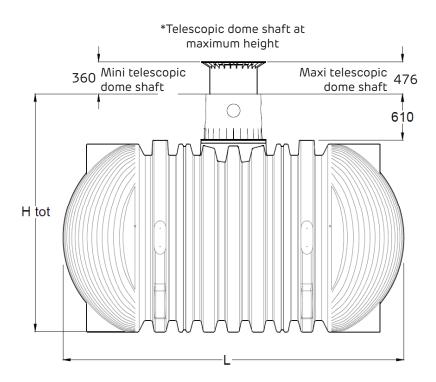

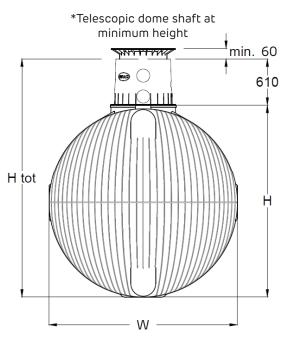


#### 2.2 Overview tanks Carat XXL

Tank (litres)	16,000	22,000	26,000	32,000	36,000	42,000	46,000	52,000	56,000
Art. No.	380001	380000	380002	380003	380004	380005	380006	380007	380008
Weight KG	750	1000	1100	1375	1470	1765	1860	2150	2250
L mm	4590	6230	7200	8440	9410	10680	11650	12920	13890
W mm					2500				
H mm	2550								
Total height mm					3160				


### 3. TANK STRUCTURE

- 1. Cover
- Telescopic dome shaft (can be inclined by 5°)
  Profile seal Telescopic dome shaft
- 4. Tank dome (can be rotated by 360°)
- 5. Tank seal Tank dome
- 6. Tank dome sealing plug
- 7. Carat XXL underground tank

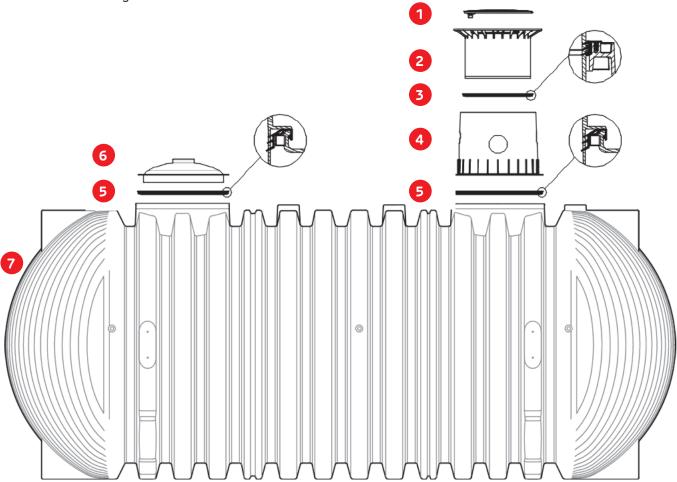

#### 4. Installation conditions

- 1. Subsoil
- 2. Telescopic dome shaft
- 3. Compact foundation
- 4. Surrounding (round-grained gravel, maximum grain size 10/20)
- 5. Covering layer
- 6. Carat XXL Underground Tank
- 7. Concrete layer for surfaces used by passenger cars
- **B** --> DIN 4124 from 1250mm depth of the trench

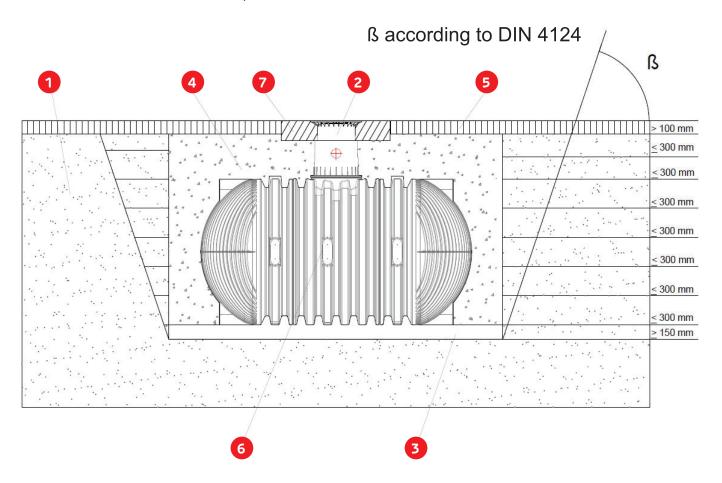

#### 4.1 Construction site

Under all circumstances, the following points must be clarified prior to installation:

- The structural suitability of the ground according to DIN 18196
- · Maximum groundwater levels which occur and drainage capability of the subsoil
- · Types of load which occur, e.g. traffic loads

An expert ground report should be requested from the local planning authority to determine the physical characteristics of the subsoil.

#### 4.2 Trench

To ensure that sufficient space is available for working, the base area of the trench must exceed the dimensions of the tank by > 500mm on each side; the distance from solid structures must be at least 1000mm.


The embankment must be designed according to DIN 4124. The construction site must be horizontal and plane and must guarantee sufficient load-bearing capacity.

The depth of the trench must be dimensioned so that the max. earth coverage (see installation conditions) above the tank is not exceeded. To use the system throughout the entire year, it is necessary to install the tank and those parts of the system which conduct water in a frost-free area. The frost-free depth is usually approx. 600mm - 800mm; precise information in this regard can be obtained from the responsible authority.

A layer of compacted, round-grained gravel (grain size 10/20, thickness approx. 150 - 200mm) is applied as the foundation.


#### 4.3 Standard installation overview

Coverage heights with telescopic dome shaft in green areas.

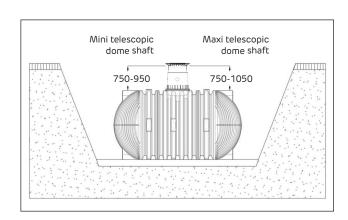


#### 4.4 Maximum cover permitted over tank

Maximum coverage heights 1500mm with extension and telescopic dome shaft.

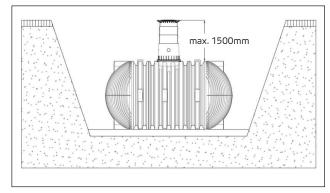

#### 4.5 Slope, embankment, etc.


On installation of the tank in the immediate vicinity (< 5 m) of a slope, earthen mound or slope, a statically calculated supporting wall must be erected to absorb the soil pressure. The wall must exceed the dimensions of the tank by at least 500 mm in all directions, and must be located at least 1000 mm away from the tank.

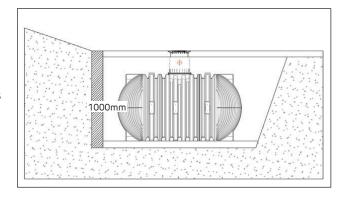

#### 4.6 Groundwater and cohesive (waterimpermeable) soils (e.g. clay soil)

With only occasional ground water and cohesive, water impermeable soils (e.g. loam), adequate drainage of the ground water or leakage water must be ensured so that the tanks never stand deeper in the ground water than indicated in the table. If necessary, the drainage line must end in a vertical DN 300 pipe in which an immersion pressure pump is installed to pump away the excessive water. The pump must be checked at regular intervals.

If it is to be expected that the tanks could sink lower, adequate drainage must be ensured in all cases. We recommend the general laying of a drainage line, since in the event of prolonged rainfall the ground water level can rise unexpectedly.

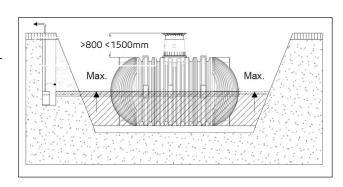


Tank	All tank sizes
Max. immersion depth	1250 mm

# 4.7 Installation below light-duty vehicle surfaces


Maximum cover heights with vehicle loading telescopic dome shaft (class B) in area driven over by vehicles up to 3.5 tonnes.

(Without groundwater or stratum water)

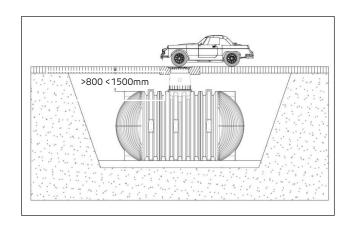


## 4.8 Installation below heavy-duty vehicle surfaces

Maximum cover heights (with cover class D - provided by customer), in area driven over by HGVs. (Without groundwater or stratum water)

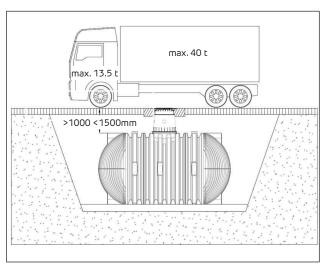

### 4.9 Installation adjacent to surfaces used by vehicles


If the underground tanks are installed adjacent to surfaces which are used by heavy vehicles weighing over 12 t, the minimum distance away from these surfaces is at least the depth of the trench.

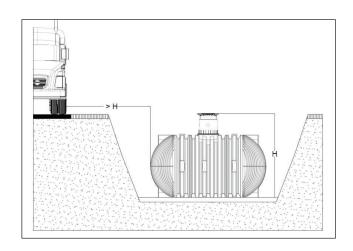

#### 4.10 Connection of several tanks

Two or more tanks are connected via the assembly surfaces by means of GRAF special seals DN 100 and basic pipes (to be provided at construction site).

The apertures must be drilled to the corresponding size using only the GRAF special crown bit. It must be ensured that the distance between the tanks is at least 600 mm. The pipes must project 100 mm - 150 mm into the tanks.

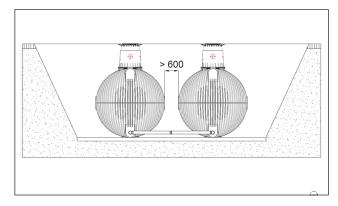


#### 4.11 Insertion and filling

The tanks must be inserted, impact-free, into the prepared trench using suitable equipment. To avoid deformities, the tank is filled approx. 25 cm with water before filling in the tank surrounding.

Afterwards the surrounding (roundgrain gravel, max. grain size 10/20) is then filled in layers of max. 40 cm steps and is compacted.

The individual layers must be well-compacted (manual tamper). Damage to the tank must be avoided during compaction. Mechanical compaction machines must not be used under any circumstances. The surrounding must be at least 500 mm wide.

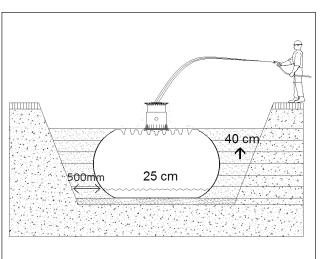


#### 4.12 Routing connections


All feed and overflow pipes must be routed with a decline of at least 1% in the direction of flow (possible, subsequent settling must be taken into consideration in this case). If the tank overflow is connected to a public sewer, this must be protected against reflux by means of a lifting station (mixed sewer) or reflux seal (pure rainwater sewer) according to DIN 1986.

All suction, pressure and control lines must be routed in an empty pipe, which must be routed as straight as possible, without bending, to the tank with a decline. Necessary bends must be formed using 30° moulded sections.

**Important:** The empty pipe must be connected to an aperture **above** the max. water level.

# 4.13 Routing connections - specific to Wastewater applications

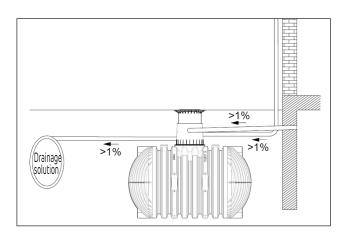

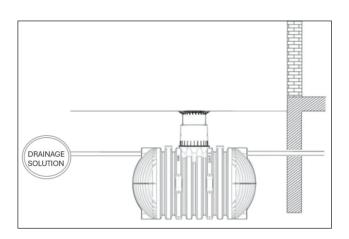



#### 5. ASSEMBLING THE TELESCOPIC DOME SHAFT


#### 5.1 Assembling the tank dome

Prior to assembly, the enclosed seal is locked onto the tank neck's profile "B". The tank dome is then aligned with the piping connections and is locked to the tank neck. It is essential to make sure that the upper seal "A" (pre-assembled) is correctly







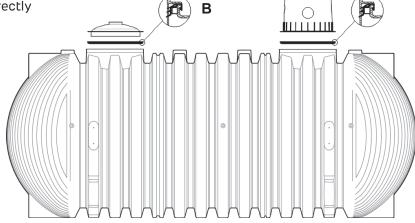


#### 5.2 Assembling the telescopic dome shaft


The telescopic dome shaft enables infinite adaptation of the tank to given site surfaces with earth coverage of between 750mm and 950mm (mini telescopic dome shaft) or 750mm and 1050mm (maxi telescopic dome shaft).

For assembly purposes, the enclosed profile seal (material EPDM) is inserted into the tank dome's sealing groove and is coated generously with soft soap (do not use mineral oil-based lubricants, as these attack the seal). The telescopic dome shaft is then greased, inserted and aligned with the surface of the site.



Important: To prevent loads from being transferred onto the tank, round-grain gravel 2 (max. grain size 10/20) is filled in layers around the telescope 1 and is evenly compacted. Damage to the tank dome 3 and telescopic dome shaft must be avoided during this step. The cover is then positioned and is sealed to prevent entry by children. Tighten the threaded connection on the cover so tightly that it cannot be opened by a child!

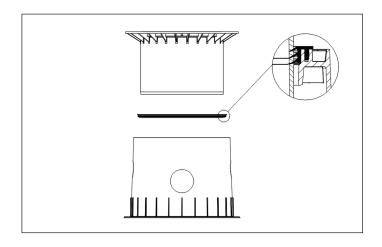

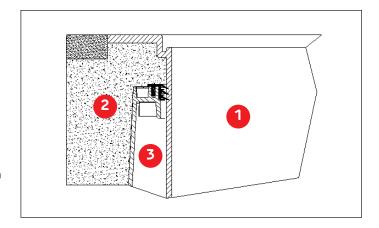

#### 5. ASSEMBLING THE TELESCOPIC DOME SHAFT

# 5.4 Telescopic dome shaft over which passenger cars may drive

If the tank is installed under areas used by passenger cars, the collar area of the telescopic dome shaft 1 (colour anthracite) must be supported with concrete 1 (load class B25 = 250 kg/m²). The layer of concrete to be installed must be at least 400 mm wide and approx. 200 mm high all around. The minimum coverage above the shoulder of the tank is at least 800 mm (max. 1050 mm with telescopic dome shaft, coverage up to max. 1500 mm possible with extension).

**Attention:** It is essential to use the vehicle telescopic dome shaft (with class B cast cover).



On installation under areas used by trucks, the telecopic dome shaft  $\ 1$  as described in 5.4. The concrete rings  $\ 1$  (diameter 600mm) and a cast frame  $\ 1$  with star-shaped load distribution for mounting the vehicle loading cover (observe earth coverage of at least 1000mm, max. 1500mm). The cast frame must have a supporting area of approx.  $1m^2$ .

**Attention:** It is essential to use a class D cover to be provided by the customer.


#### 5.6 Assembling the extension


For larger coverage heights an extension is needed. To insert the extension into the tank dome, soft soap is needed. Into the highest groove of the extension the profile seal is inserted and greased generously. Afterwards push the telescopic dome shaft onto the extension and adjust it to the planned area surface.


#### max. earth-cover 1500mm

(in each case in connection with the Maxi telescopic dome shaft).

- 1 Telescopic dome shaft (can be inclined by 5°)
- 2 Extension
- Tank dome (can be rotated by 360°)

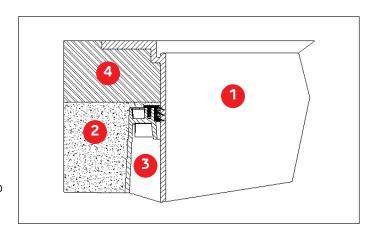

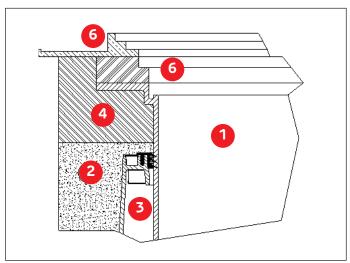

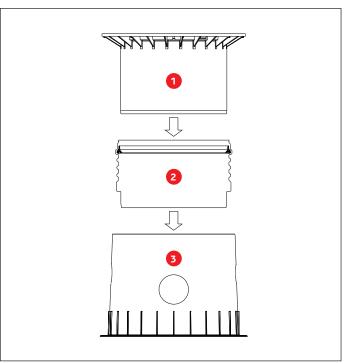

#### **6. INSPECTION AND SERVICING**

The entire system must be checked for leaks, cleanliness and stability at least every three months.

The entire system should be serviced at intervals of approx. 5 years. In this case, all parts of the system must be cleaned and their function checked. Servicing should be carried out as follows:

- · Drain the tank completely
- · Clean surfaces and internal parts with water
- Remove all dirt from the tank
- · Check that all internal parts are firmly connected.

The points described in these instructions must be observed under all circumstances. All warranty rights are invalidated in the event of non-observance. Separate installation instructions are enclosed in the transportation packaging for all additional articles purchased from GRAF.

The components must be checked for any damage prior to installation under all circumstances.

Missing instructions can be downloaded on www.graf.info or can be requested from GRAF.

### 7. NOTES

8. NOTES


### 8. NOTES





Graf UK Ltd

Regen House Beaumont Road Banbury

Oxfordshire OX16 1RH

T: 01608 661500 F: 01295 211333 E: info@grafuk.co.uk www.grafuk.co.uk Graf UK Ltd (Scotland)

220 Blairtummock Road Queenslie Industrial

Estate

Glasgow G33 4ED

T: 0141 465 1540 F: 01295 211333 E: info@grafuk.co.uk www.grafuk.co.uk